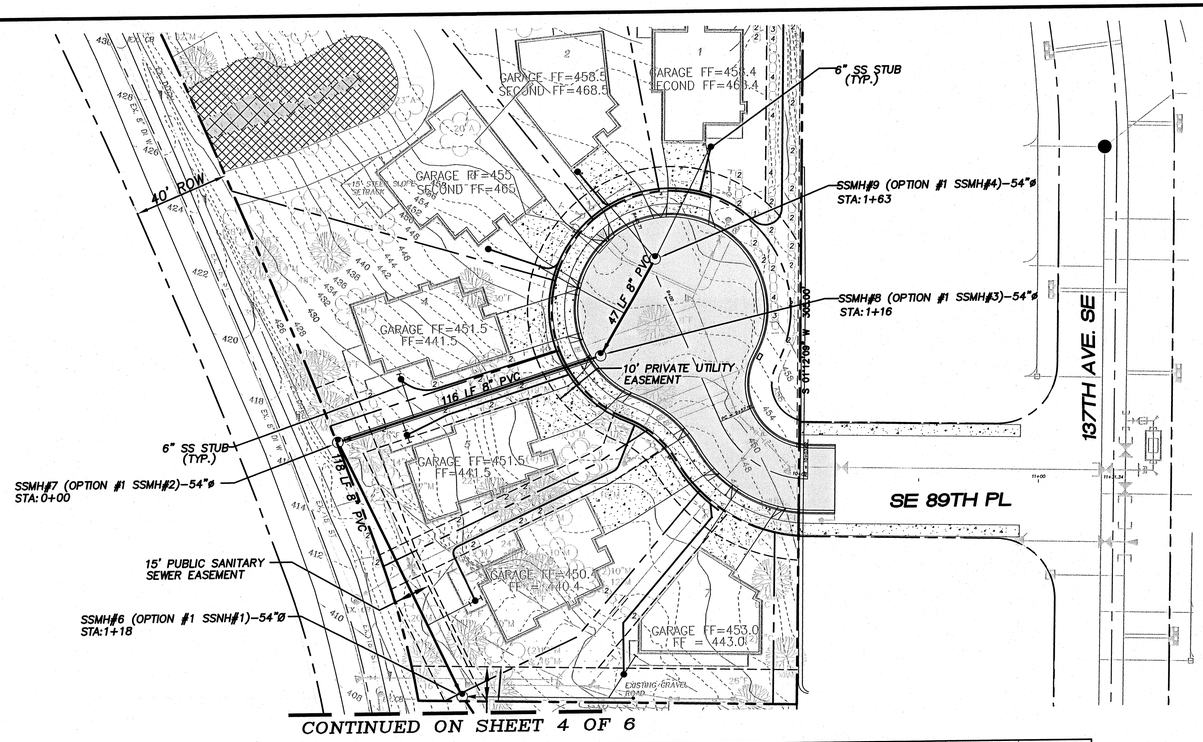

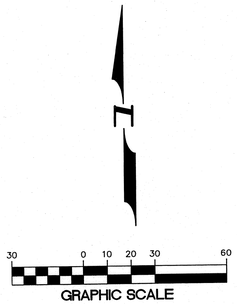

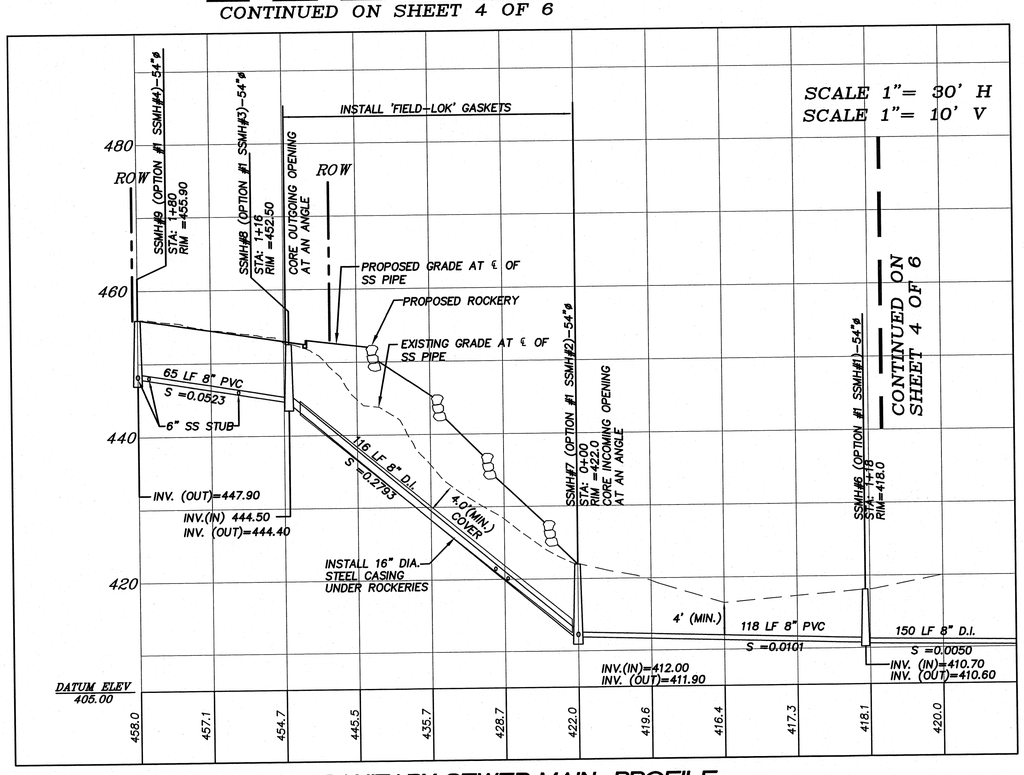

SANITARY SEWER MAIN PROFILE

GENERAL NOTES

1. CONSTRUCTION SHALL BE IN ACCORDANCE WITH COAL CREEK UTILITY DISTRICT STANDARD SPECIFICATIONS.
2. WHERE THE WATER MAIN CROSSES OVER SANITARY SEWER, THE MINIMUM VERTICAL SEPARATION SHALL BE 18 INCHES, OR CONSTRUCTION SHALL BE IN ACCORDANCE WITH D.O.E. CRITERIA FOR SEWAGE WORKS DESIGN (SEE DETAILS).
3. ALL SIDE SEWER TEES SHALL BE FIELD LOCATED
4. SECURE SIDE SEWER PERMITS FROM DISTRICT PRIOR TO INSTALLING SIDE SEWERS.
5. MANHOLE RING COVERS SHALL BE SLOPED TO MATCH THE GRADE OF THE STREET IN WHICH THEY ARE PLACED.
6. STREETS SHALL BE CONSTRUCTED TO SUBGRADE PRIOR TO INSTALLING THE SANITARY SEWERS.
7. SIDE SEWERS TO BE EXTENDED 10 FEET INTO THE LOTS.

CALL BEFORE YOU DIG
Call: TOLL FREE
1-800-424-5555

18612 REGISTERED PROFESSIONAL ENGINEER
EXPIRES: MAY 6, 2009

PLOT DATE & TIME
FILE NAME (UPDATED BY)

SYM	REVISION	DATE	BY	APP'D
	REVISED PER COAL CREEK UTILITY DISTRICT COMMENTS	09/17/08	JGC	DGS
	ADD FORCE MAIN/PRESENT TWO OPTIONS	08/21/08	JGC	DGS

DESIGNED
DRAWN JRL
CHECKED DGS

Pacific Engineering Design, LLC
15445 53RD AVE. S. SEATTLE, WA 98188
PHONE: (206) 431-7970 FAX: (206) 388-1648 WEB SITE: PACENG.COM
Civil Engineering and Planning Consultants

COAL CREEK UTILITY DISTRICT
6801 132ND PLACE S.E.
NEWCASTLE, WASHINGTON 98059

REFERENCE INFORMATION
FIELD BOOK:
SURV. CPU FILE:
DATUM: NGVD29

DATE: JULY 26, 2007
SCALE: NOTED

VARNEY SEWER EXTENTION SANITARY SEWER MAIN ON-SITE PLAN AND PROFILE OPTION #2

JOB NUMBER 07020.00
DWG NO. 06015SS.DWG
SHEET 3 OF 7
JOB NO. 06015