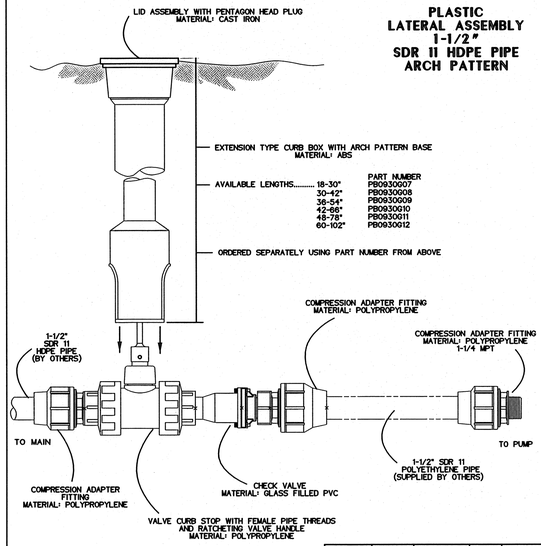

PLASTIC LATERAL ASSEMBLY 1-1/2" SDR 11 HDPE PIPE ARCH PATTERN

PRESSURE RATING: 150 psi

ASSEMBLY TO BE USED WITH 1-1/2" SDR 11 PIPE ONLY

TO ORDER LATERAL ASSEMBLY SHOWN, USE PART NUMBER PC0645022.

ORDER CURB BOX SEPERATE: SEE ABOVE.

AD	SFG	12/16/04	-	3/16
DR BY	CHK'D	DATE	ISSUE	SCALE

e one SEWER SYSTEMS

PLASTIC LATERAL ASSEMBLY
1-1/2" SDR 11 HDPE PIPE ARCH PATTERN

PA1998P01

WH231

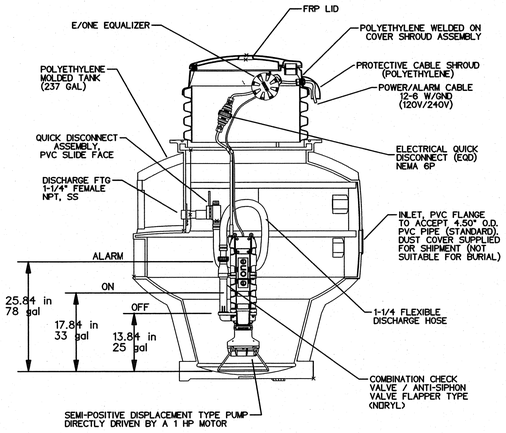

NOTE:
1012s-55 WITH A FLAT FIBERGASS LID IS ALSO AVAILABLE
VOLUME INCREASES 2 GALLONS PER INCH OVER 60" HIGH

BALLAST REQUIREMENTS

A CONCRETE ANCHOR IS REQUIRED ON ALL 1012s STATIONS

SPECIFIC CONCRETE DIMENSIONS ARE REQUIRED TO ACHIEVE NECESSARY BALLAST EFFECT

SEE INSTALLATION INSTRUCTIONS FOR FURTHER DETAILS

CTT		06/26/07	A	
DR BY	CHK'D	DATE	ISSUE	SCALE

e one SEWER SYSTEMS

DETAIL SHEET, WH231

NA0059P02

WH231-73

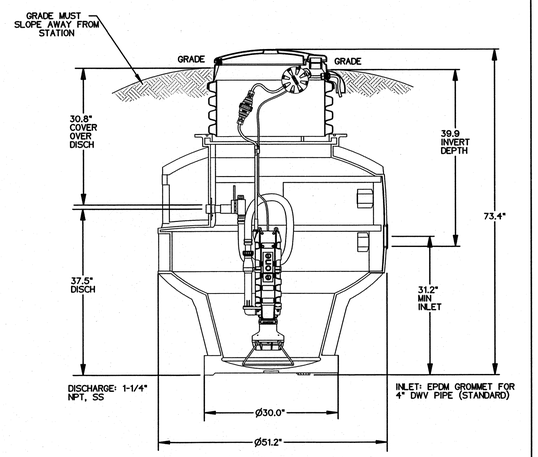

BALLAST REQUIREMENTS

A CONCRETE ANCHOR IS REQUIRED ON ALL 1012s-73 STATIONS

SPECIFIC CONCRETE DIMENSIONS ARE REQUIRED TO ACHIEVE NECESSARY BALLAST EFFECT

SEE INSTALLATION INSTRUCTIONS FOR FURTHER DETAILS

CTT		06/27/07	A	
DR BY	CHK'D	DATE	ISSUE	SCALE

e one SEWER SYSTEMS

MODEL WH231-73

NA0059P□4

CALL BEFORE YOU DIG
Call: TOLL FREE
1-800-424-5555

18612 REGISTERED PROFESSIONAL ENGINEER
EXPIRES: MAY 6, 2009

FILE NAME (CREATED BY) | PLOT DATE & TIME

DESIGNED
DRAWN JRL
CHECKED DGS

SYM	REVISION	DATE	BY	APP'D

Pacific Engineering Design, LLC
15445 53RD AVE. S. SEATTLE, WA 98188
PHONE: (206) 431-7970 FAX: (206) 388-1648 WEB SITE: PACENG.COM
Civil Engineering and Planning Consultants

COAL CREEK UTILITY DISTRICT
6801 132ND PLACE S.E.
NEWCASTLE, WASHINGTON 98059

REFERENCE INFORMATION
FIELD BOOK:
SURV. CPU FILE:
DATUM: NGVD29

DATE: SEPT. 17, 2008
SCALE: NOTED

VARNEY SEWER EXTENTION
SANITARY SEWER PLAN
OPTION #1

JOB NUMBER 07020.00
DWG NO. 060155S.DWG
SHEET 7 OF 7