


S.E. 1/4, SEC. 27, T. 21 N., R. 4 E., W.M.

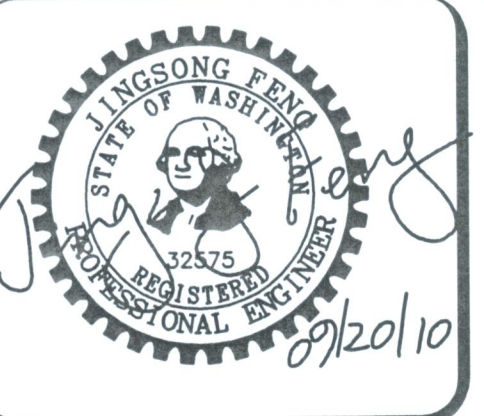



15415 53RD AVE S.
SEATTLE, WA 98188
PHONE: (206) 431-7970
FAX: (206) 388-1648
WEB SITE: PACENG.COM

Pacific Engineering Design, LLC

Civil Engineering and Planning Consultants

BUILDING PERMIT
RAM NIWAS CHURCH
FOR: SATGURU RAM SINGH STANG
15701 168TH PLACE SE
RENTON, WA 98058
PHONE: (206) 304-1911

PROJECT NO.: 10021
DRAWN BY: ENM
ISSUE DATE: 7-23-2010
SHEET REV.: 9-20-2010

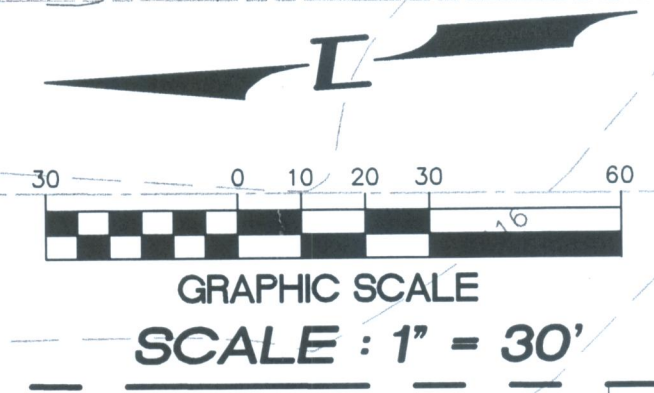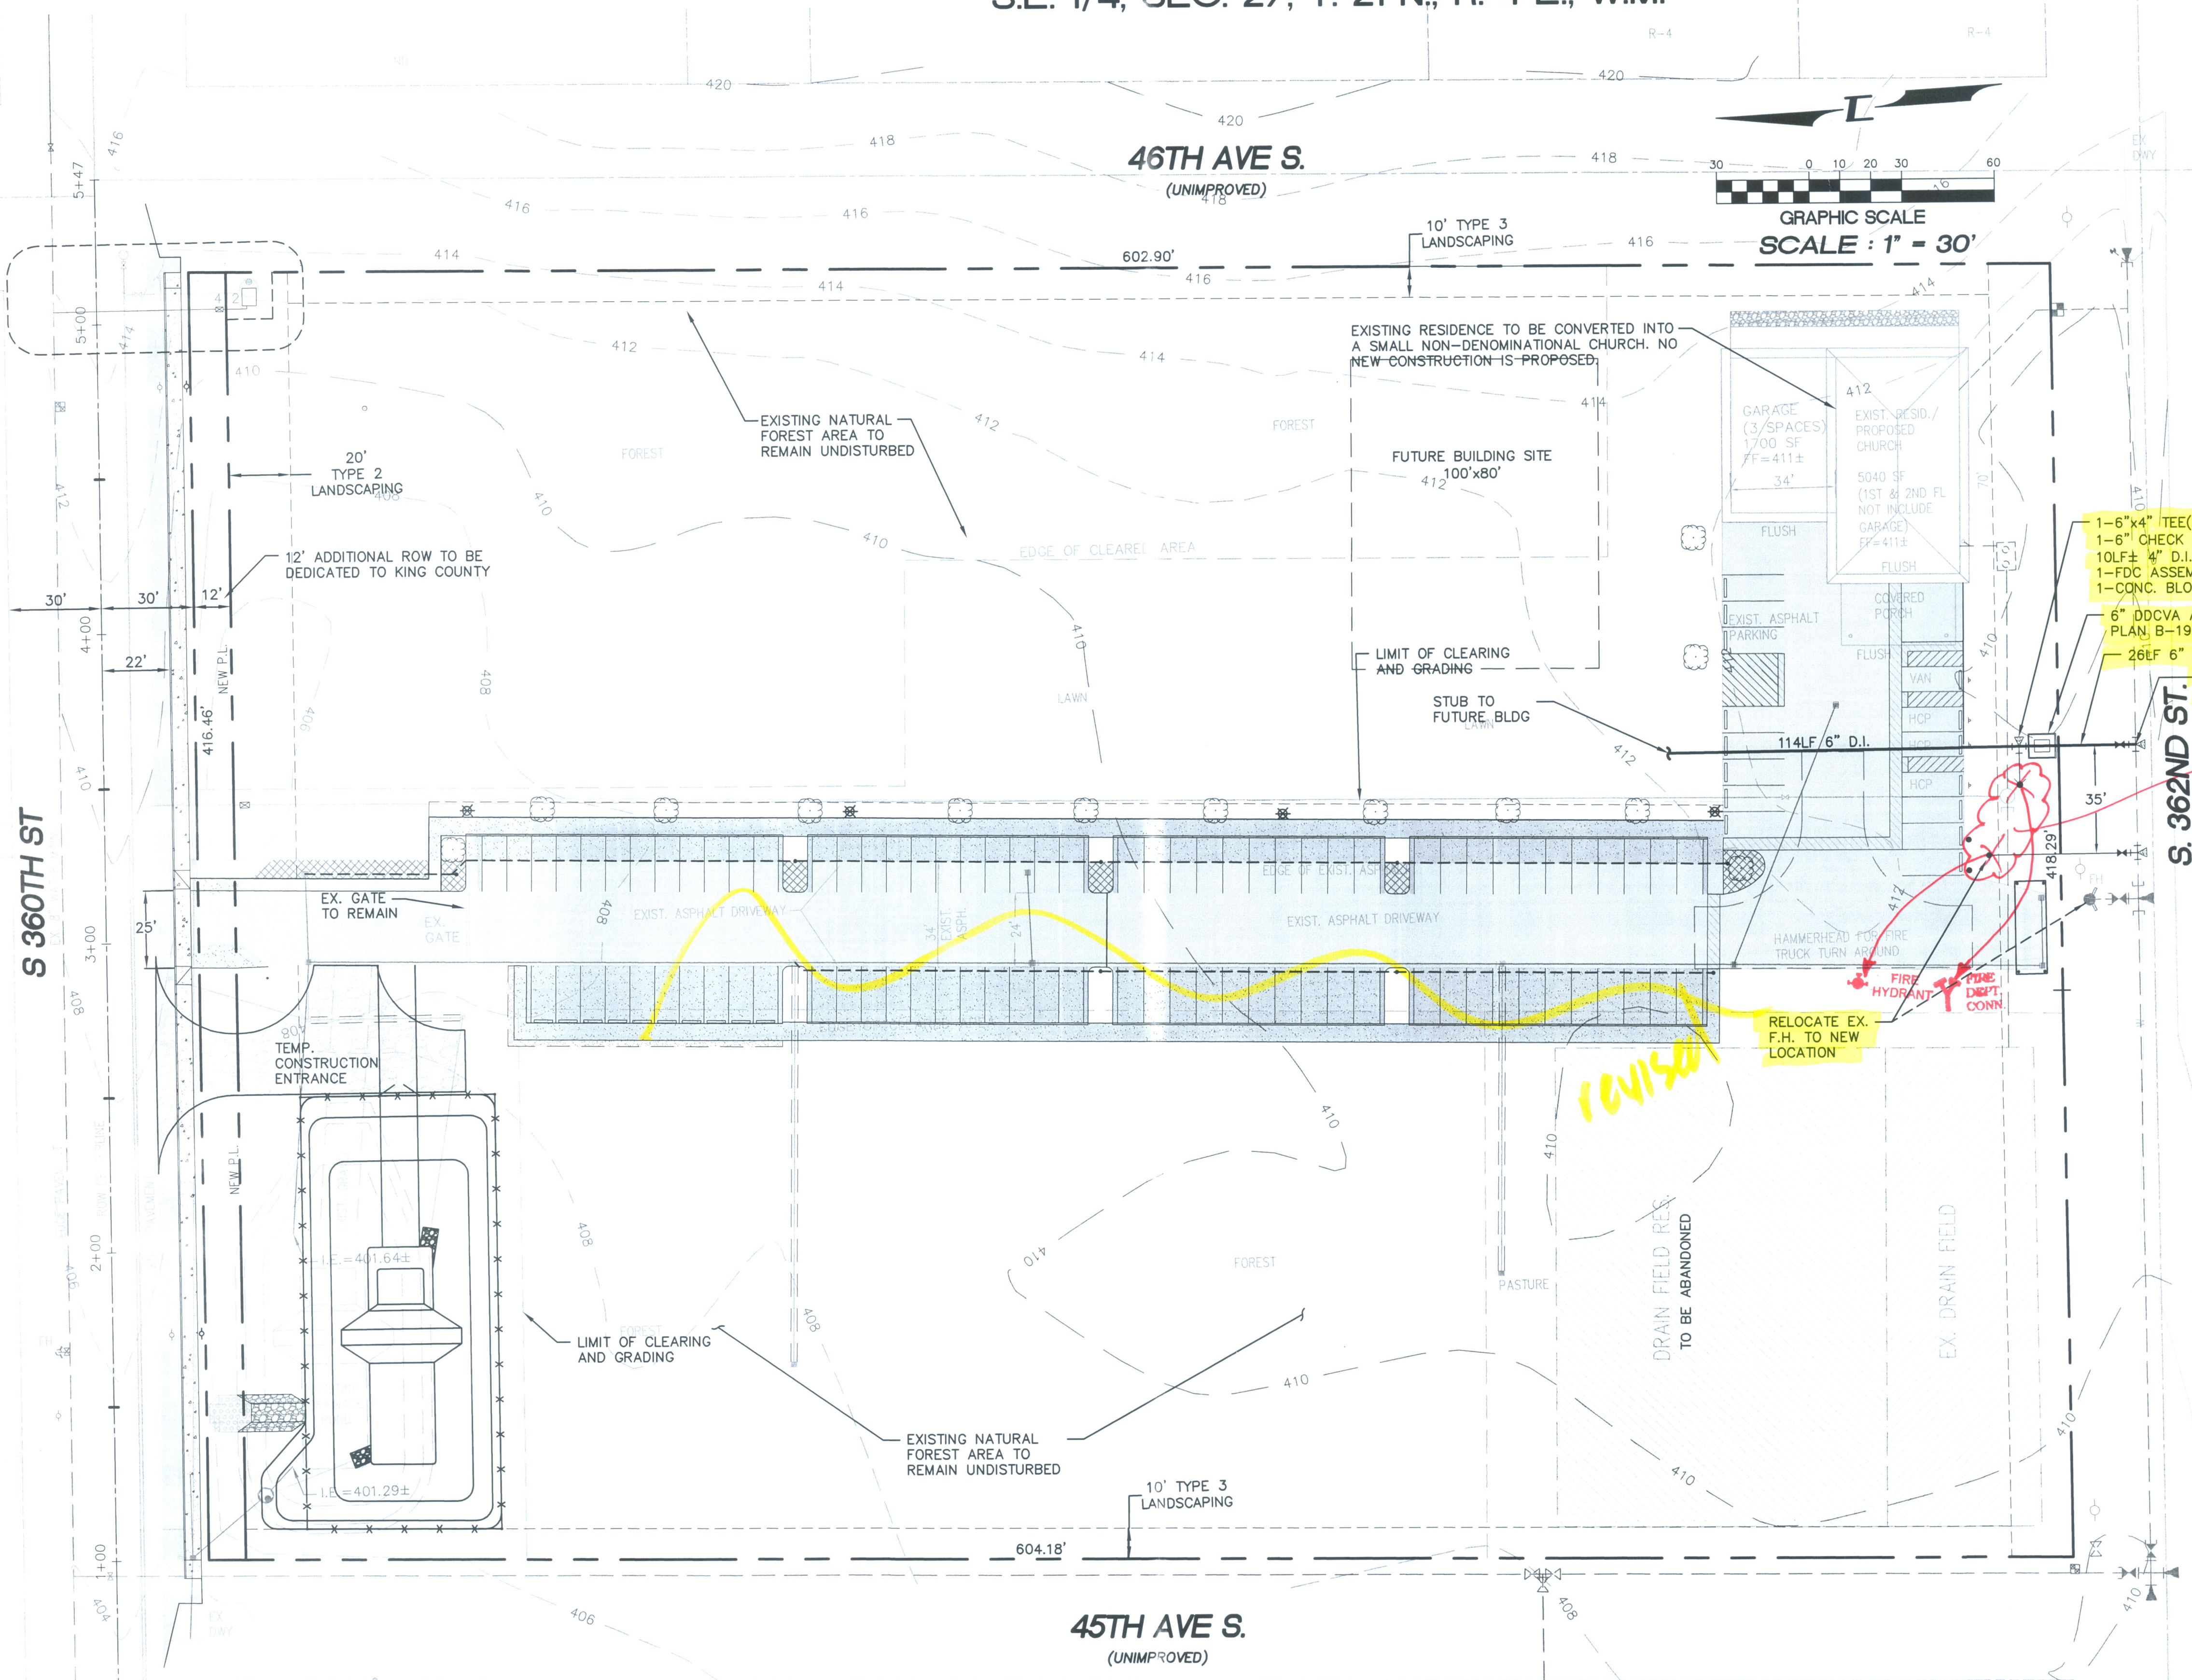

- 1-6"x4" TEE(M.J)
- 1-6" CHECK VALVE
- 10LF 4" D.I. WATER
- 1-FDC ASSEMBLY
- 1-CONC. BLOCKING
- 6" ODCVA ASSEMBLY PER LUD STANDARD PLAN: B-19D IN UTILITY VAULT 676-WA
- 26LF 6" D.I.
- 1- 8"x6" TAP-IN TEE
- 1-6" GATE VALVE W/ VALVE BOX (MjxFL)
- 1-CONC. BLOCKING

FIRE HYDRANT AND F.D.C. CANNOT BE OBSTRUCTED BY PARKED VEHICLES.

NOTE

- BUILDING TO BE EQUIPPED WITH NFPA 13 AUTOMATIC SPRINKLER SYSTEM PER TITLE 17 OF KING COUNTY CODE
- BUILDING TO BE EQUIPPED WITH MONITORED AUTOMATIC FIRE ALARM SYSTEM PER NFPA 72.
- KITCHEN TO EQUIPPED WITH UL300 FIXED FIRE SUPPRESSION SYSTEM

** SEPARATE FIRE ENGINEERING PERMITS REQUIRED FOR: HYDRANT(S)/WATERMAIN EXTENSION, SPRINKLER OR FIXED SUPPRESSION SYSTEM(S), UNDERGROUND SUPPLY LINE (S) FOR SPRINKLER SYSTEM(S) AND F.D.C.'S, FIRE ALARM SYSTEM(S), MONITORING SYSTEMS. - UL300 SYSTEM IN KITCHEN*

** ABOVE INSTALLATIONS ARE NOT APPROVED AS PART OF THIS PERMIT.*

LEGEND

- 465 - EXISTING GRADE
- PROPERTY LINE
- TEE WITH CONC. BLOCKING
- FIRE HYDRANT ASSEMBLY
- FIRE DEPARTMENT CONNECT

APPROVED FOR CONSTRUCTION
DEPARTMENT OF DEVELOPMENT & ENVIRONMENTAL SERVICES
King County, Washington
Date _____ Molly A. Johnson, P.E.
Development Engineer

VOID EXCEPT FOR WATER PLAN

FFLOW needed as

C05

4-21-11