



NOTES:

- 1. ALL PIPE SLOPES NOTED ARE FT/FT.
- 2. ALL SANITARY SEWER MANHOLES ARE STATIONED TO CENTER OF STRUCTURE
- 3. ALL PVC PIPE SHALL BE SDR-35 UNLESS OTHERWISE NOTED
- 4. SIDE SEWERS TO BE INSTALLED PER C.O.A. STD. DTL. SEWER-01 AND SEWER-02 5. SEWER STUBS TO BE MARKED USING A PAINTED
- 2"x4" MARKED "SEWER"
- 6. WATER SERVICE STUBS TO BE MARKED USING A PAINTED 2"x4" MARKED "WATER"
- 7. ALL SIDE SEWERS ARE STATIONED FROM THE NEAREST DOWNSTREAM MANHOLE
- 8. ALL WATER METERS SHALL BE \$ INCH PER C.O.A. STANDARD DETAIL WATER-13, 1" MINIMUM SERVICE LINE BETWEEN MAIN AND \$ INCH METER.
- 9. SANITARY SEWER MANHOLES SHALL BE EQUIPPED WITH A SOLID LOCKING LID WITH THE WORDS "CONFINED SPACE - PERMIT REQUIRED" CAST INTO LID.



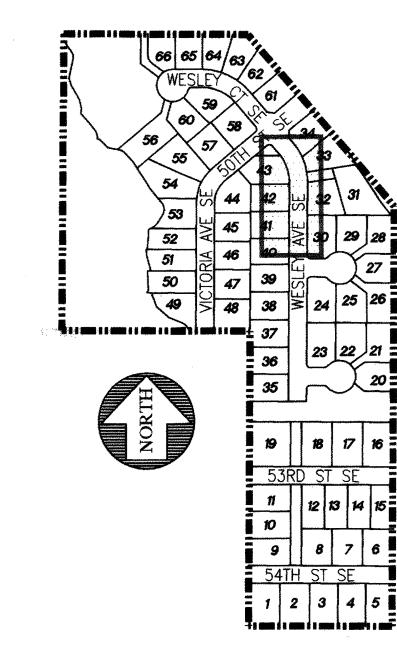


LEGEND

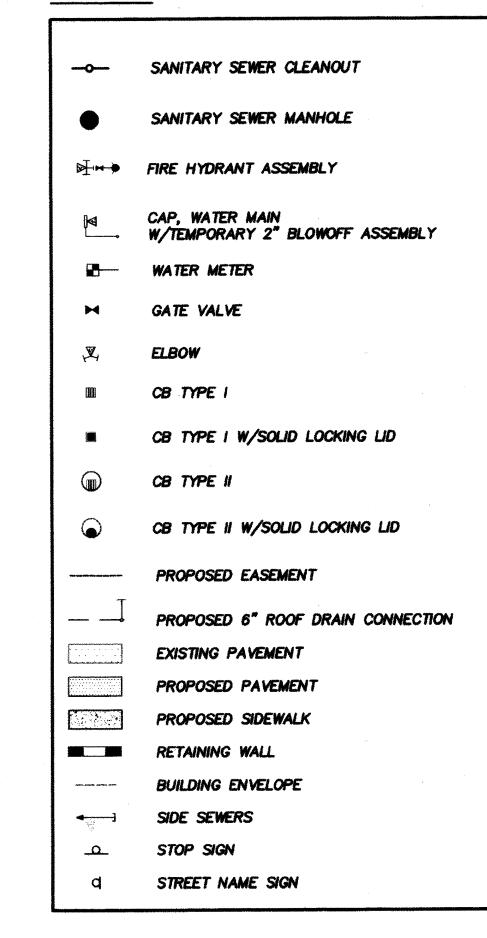

RECORD DRAWING CERTIFIC THESE DRAWINGS CONFORM CONSTRUCTION RECORDS.	
BY:	DATE
TITLE/POSITION:	
CONFIRMED BY CITY:	DATE
PROJECT REF: FACO7-0 HS May 10, 201 THESE PLANS ARE "APPROVE THE CITY OF AUBURN'S ENGINE REQUIREMENTS.	3 FOR CONFORMANCE WITH
APPROVED BY:	ni Solle

DATE APPROVED:__



592013

PROJECT NO.: 12022

DRAWN BY: ENM

ISSUE DATE: 07-17-07

SHEET REV.: 3-20-2013

WATER AND SEWER PLAN AND PROFILE (WESLEY AVE. STA. 4+00-7+25)

05056WA08-C27.DW SHEET 40 OF 55